













SIRENA s.p.a.IP 65  **MLINE | XLF JUNIOR DIRECTIONAL****MLINE | XLF JUNIOR PROXIMITY**

- ISTRUZIONI DI INSTALLAZIONE E UTILIZZO - INSTALLATION AND APPLICATION INSTRUCTIONS -
 - INSTRUCTIONS D'INSTALLATION ET D'UTILISATION - INSTALLATIONS- UND BEDIENTUNGSANLEITUNG -
 - INSTRUCCIONES DE INSTALACIÓN Y EMPLEO -

XLF JUNIOR**LT SHALLOW**
LT DEEP
MT DEEP
HT DEEP
HT DEEP JUNIOR
**BOB**
LT WALL
MT WALL
HT WALL
HT WALL JUNIOR

LT DOUBLE
MT DOUBLE
HT DOUBLE

LT FLUSH
MT FLUSH
HT FLUSH
**XLF + SHALLOW****XLF + DEEP****XLF + WALL****XLF + FLUSH****XLF + DOUBLE****XLF JUNIOR LT**

V_~	12+24
V_~	
mA	115 115

XLF JUNIOR MT

V_~	30+80
V_~	
mA	250 100




XLF JUNIOR HT

V_~	90+240
mA	85 55






ATTENZIONE	Assicurarsi di tagliare tensione prima di intervenire sul prodotto
WARNING	Disconnect power supply before making any intervention on the device
ATTENTION	Ressembler d'avoir coupé l'alimentation avant d'intervenir sur le produit
ACHTUNG	Vor Öffnen des Gerätes diese spannungsfrei schalten
ADVERTENCIA	Desconectar la tensión eléctrica antes de trabajar en el equipo

FUSIBILE DI PROTEZIONE	Sulle linee di alimentazione utilizzare fusibili ricercati dimensionati a seconda della tensione
FUSE WIRE PROTECTION	On the power supply line the rating of the supply fuse must be according to the voltage
FUSIBLE DE PROTECTION	Sur la ligne d'alimentation utiliser des fusibles réterdes dimensionnés selon la tension
SCHUTZSICHERUNG	Für die Zuleitung träge Sicherungen verwenden, die nach der Spannung zu bemessen sind
FUSIBLE DE PROTECCION	En la línea de alimentación emplear fusibles de seguridad adecuados al voltaje

CABLAGGIO/WIRING/CÂBLAGE/VERKABELUNG/CABLEADO
BASES LT (12÷24V DC/AC)

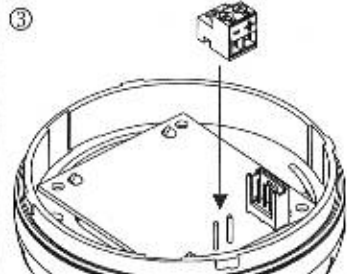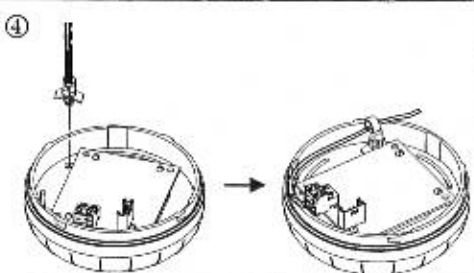
XLF JUNIOR LT SHALLOW / XLF JUNIOR LT DEEP / XLF JUNIOR LT WALL / XLF JUNIOR LT DOUBLE / XLF LT FLUSH			12÷24V DC/AC
① 	②  Luce fissa Steady light Lumière fixe Dauerlicht Luz fija	③ 	
④ 			

CABLAGGIO/WIRING/CÂBLAGE/VERKABELUNG/CABLEADO
BASES MT (30÷80V DC/AC) and BASES HT (90÷240V AC)

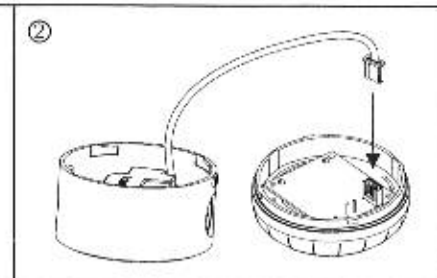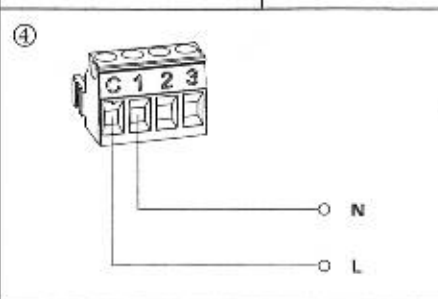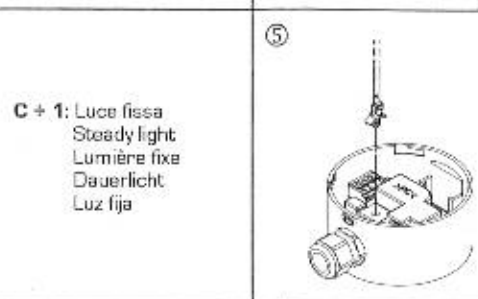
XLF JUNIOR MT DEEP		30÷80V DC/AC	XLF JUNIOR HT DEEP		90÷240V AC
①					
②					
③					
④	 C + 1: Luce fissa Steady light Lumière fixe Dauerlicht Luz fija				
⑤					

XLF JUNIOR MT WALL 30÷80V DC/AC		XLF JUNIOR HT WALL 90÷240V AC	
①	②	③	
④	C ÷ 1: Luce fissa Steady light Lumière fixe Dauerlicht Luz fija		
	⑤		

XLF JUNIOR MT DOUBLE		30÷80V DC/AC		XLF JUNIOR HT DOUBLE		90÷240V AC	
①		②		③		④	
⑤		UPPER XLF C ÷ 1: Luce fissa Steady light Lumière fixe Dauerlicht Luz fija					
		LOWER XLF C ÷ 4: Luce fissa Steady light Lumière fixe Dauerlicht Luz fija					
⑥							

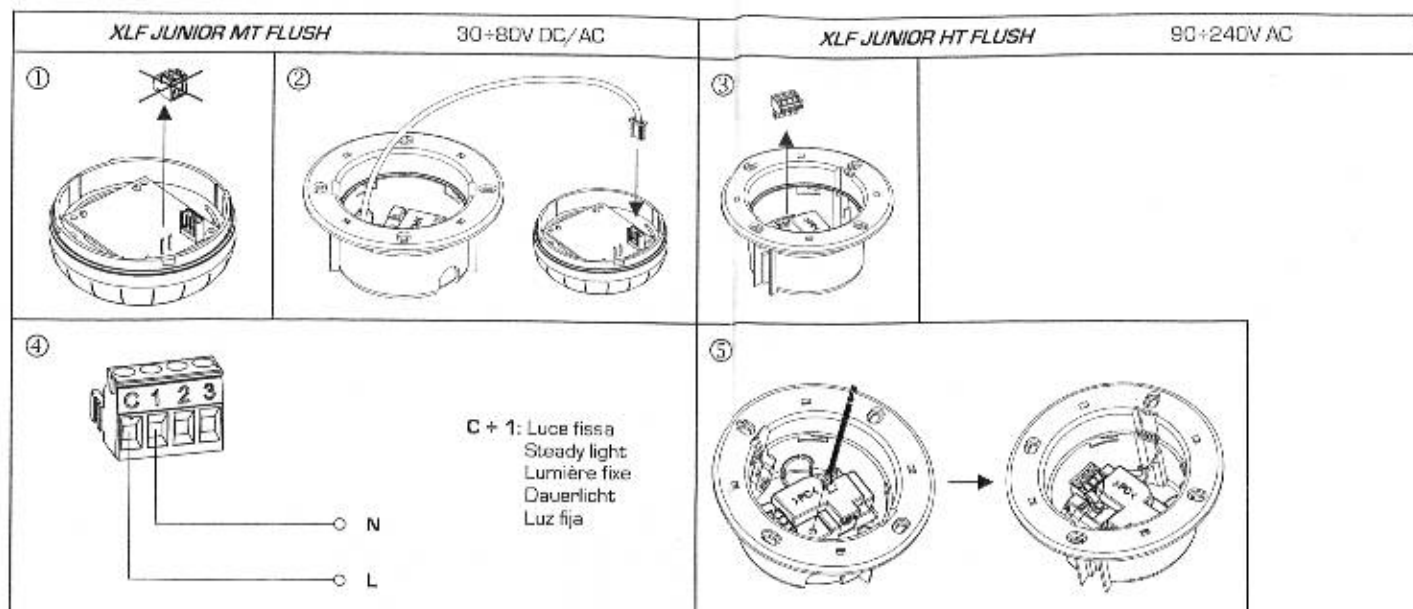

**BLOCCAGGIO CUPOLE/DOME TIGHTENING/SERRAGE DU DÔME
ANZIEHEN DER HAUBE/APRIETE DE LA CUPULA**

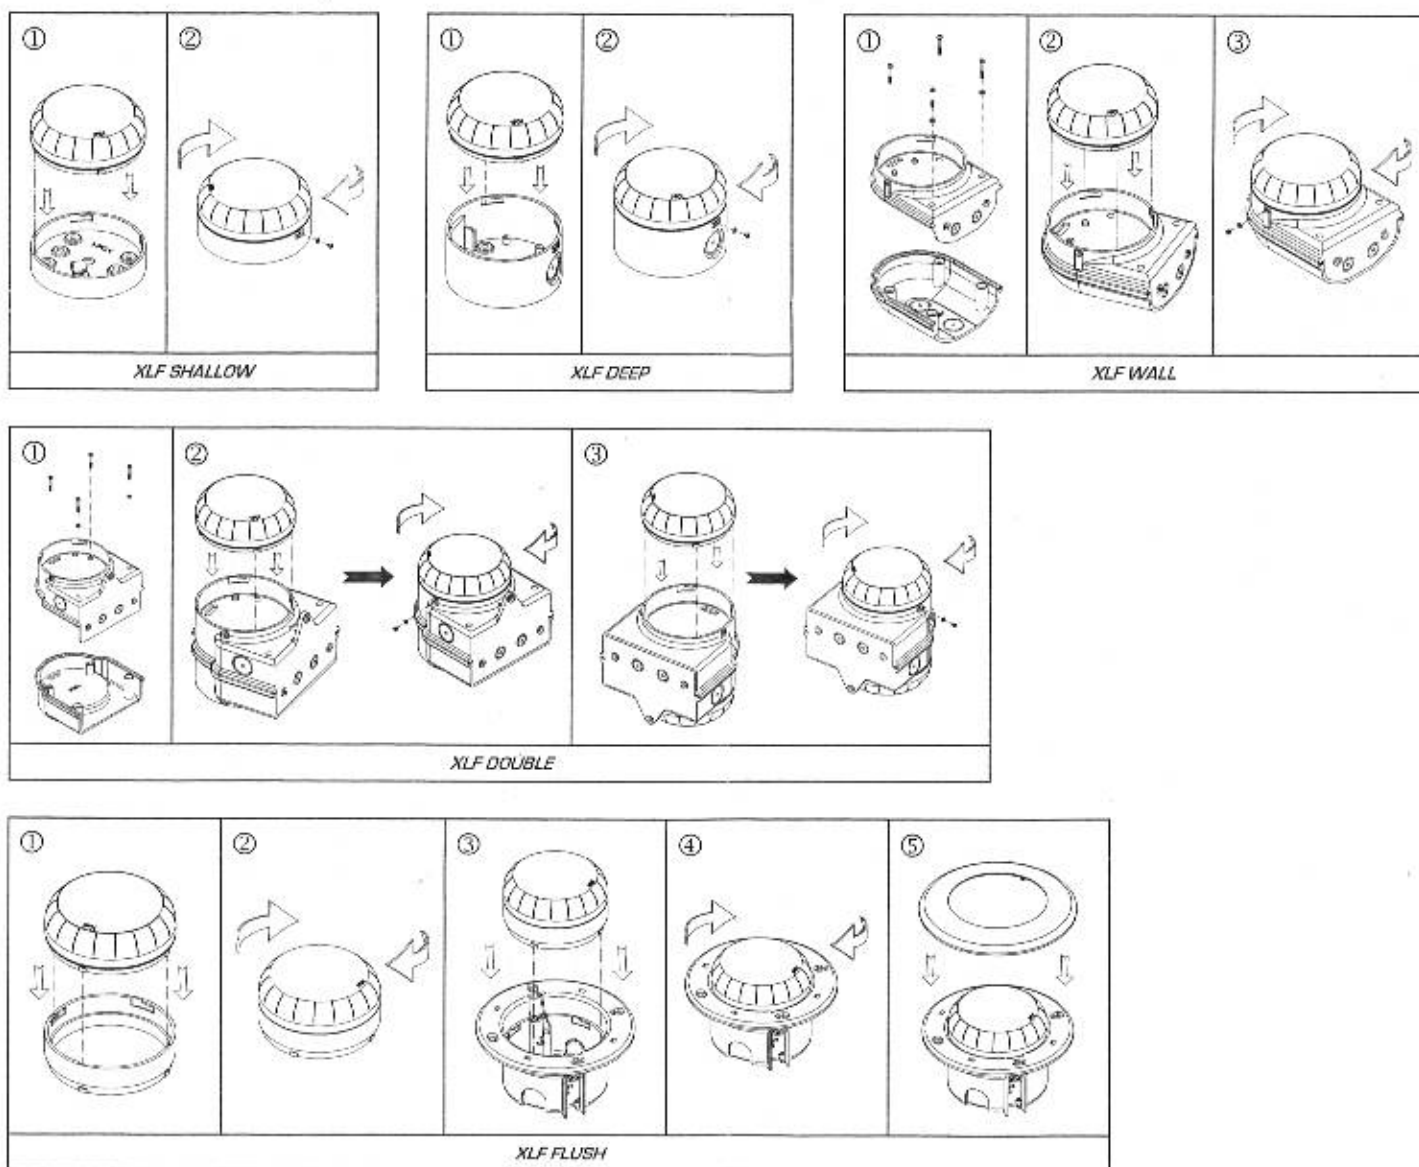

NON SMALTIRE COME RIFIUTO URBANO - NOT TO BE DISPOSED OF AS COMMON WASTE - NE PAS ELIMINER COMME DECHET URBAIN
NICHT ÜBER DIE NORMALE SAMMLUNG VON HAUSMÜLL ENTSORGEN - NO ELIMINAR COMO DESECHO URBANO

SIRENA s.p.a.

C.so Monconisio, 5-10-12-14-16 ROSTA (TO) 10090 - Italia Tel. +39 0119568555 (25 linee ISDN)
Telegr. SIRENA 10090 ROSTA - Fax +39 0119567928 - 0119568510 www.sirena.it - E-mail: sirena.sp@irena.it

11/2014 - Ref. 312006906